


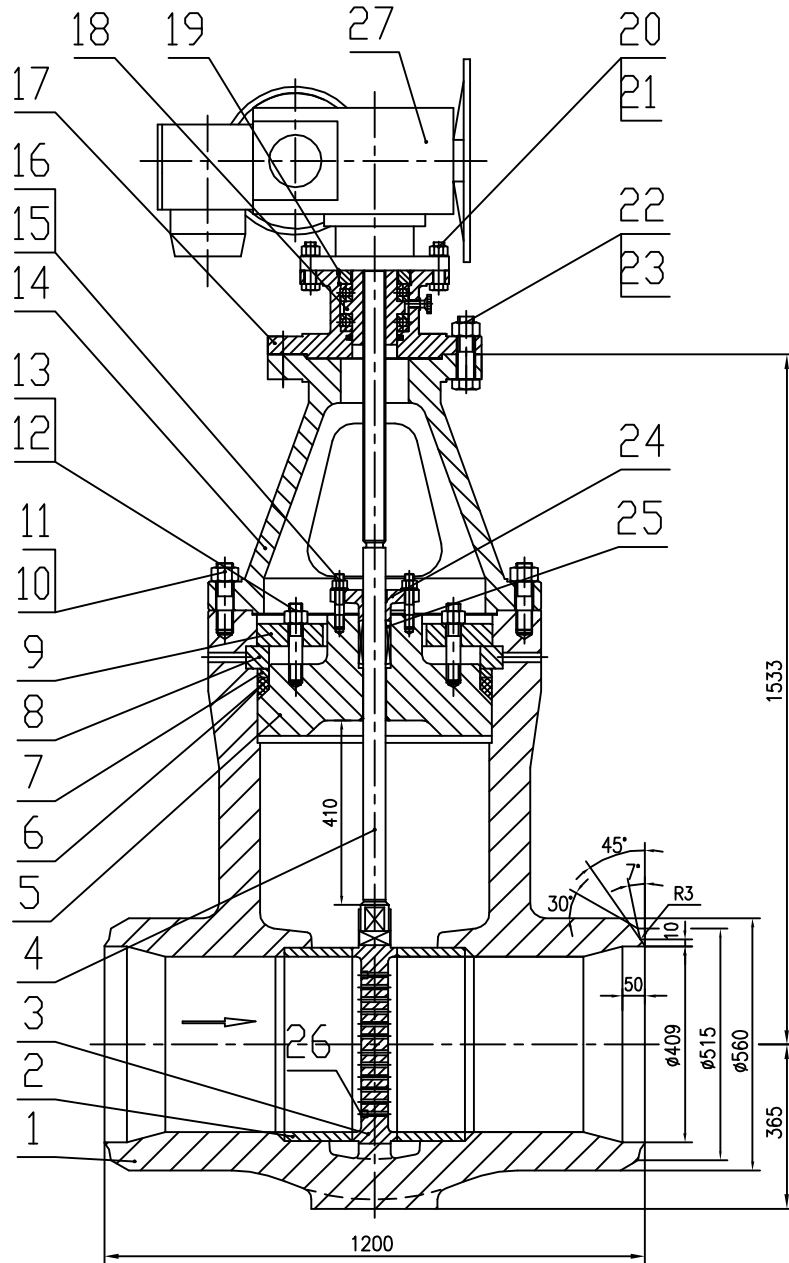

Note:
1.DIMENSIONS UNIT:mm
2.THE APPLICATION OF DOMESTIC VALVE PLEASE
REFER TO THE TECHNICAL SPECIFICATION AND
DATASHEET FOR DOMESTIC VALVE
TB2-SDC.VP101-00100-M-M1A-DAS-0024

PERFORMANCE STANDARD		
Name	Unit	Digital
Valve type	✓	L965Y-320
Nominal Diameter	DN	500
Nominal Pressure	Mpa	32
Hydro-static strength test pressure	Mpa	48
Hydro-static seal test pressure	Mpa	35.2
Standard	✓	ASME
Tubing Size	✓	ø508x55

27	Electric Actuator	IQ70/IB10(6:1)
26	BOLT	420
25	PACKING	Graphite
24	PACKING PLATEN	1035
23	NUT	1025
22	BOLT	1035
21	NUT	1025
20	BOLT	1035
19	BOLT	1035
18	STEM NUT	C61400
17	FLANGE	A105
16	NUT	1025
15	BOLT	1035
14	BRACKET	A105
13	NUT	1025
12	BOLT	1035
11	NUT	1025
10	BOLT	1035
9	SUPPORT PLATE	A105
8	PENDANT COLLET	38CrMoA1A
7	RING	1035
6	GASKET RINGS	316+Graphite
5	BOONET	WCB
4	STEM	38CrMoA1A
3	DISC	316
2	SEAT	316
1	BODY	WCB
No.	NAME	Material

KKS: 12LAB10AA002

KKS: 22LAB10AA002

Daelim Industrial Co., Ltd.	
Job No.	110180
A - APPROVED	
B - APPROVED WITH COMMENTS	
C - RETURNED FOR CORRECTION	
D - REJECTED	
N - NOT APPLICABLE (REFERENCE ONLY)	
SIGNED BY :	DATE :
DIE'S PERMISSION TO PROCEED OR REVIEW TAKEN ON VENDOR PRINTS SHALL NOT RELIEVE VENDOR FROM ITS RESPONSIBILITIES OR LIABILITIES UNDER THE PURCHASE ORDER.	

DOCUMENT SUBMISSION STATUS: RE

NOTE:

15 Jan.2016	FOR REFERENCE	REVISIONS	REVISIONS	REVISIONS	REVISIONS
REV	DATE	DESCRIPTION	DRWN	CHKD	REVD
OWNER					
ENGINEER					
DESIGNER					
CHECKER					
APPROVER					
DATE					
PROJECT TITLE	THAI BINH2 THERMAL POWER PLANT 2 x 600MW				
DRAWING TITLE	DOMESTIC VALVE L965Y-320 DN500 THROTTLING VALVE				
VENDOR NAME	青島电站阀门有限公司	FUNCTION	NAME	DATE	DATE
QSD	Qingdao Power Station Valve Co., Ltd.	DRWN	LIUJING	15 Jan.2016	15 Jan.2016
		CHKD	SUNJING	15 Jan.2016	15 Jan.2016
		REVD	HONGJING	15 Jan.2016	15 Jan.2016
		APPD	ZHONGJING	15 Jan.2016	15 Jan.2016
DRAWING NO.	TB2-SDCVP101-00100-M-M1A-DAS-0002	JOB NO.	110180	SCALE	REVISION